


MAY 1919  
SAN ANSELMO  
CAL.

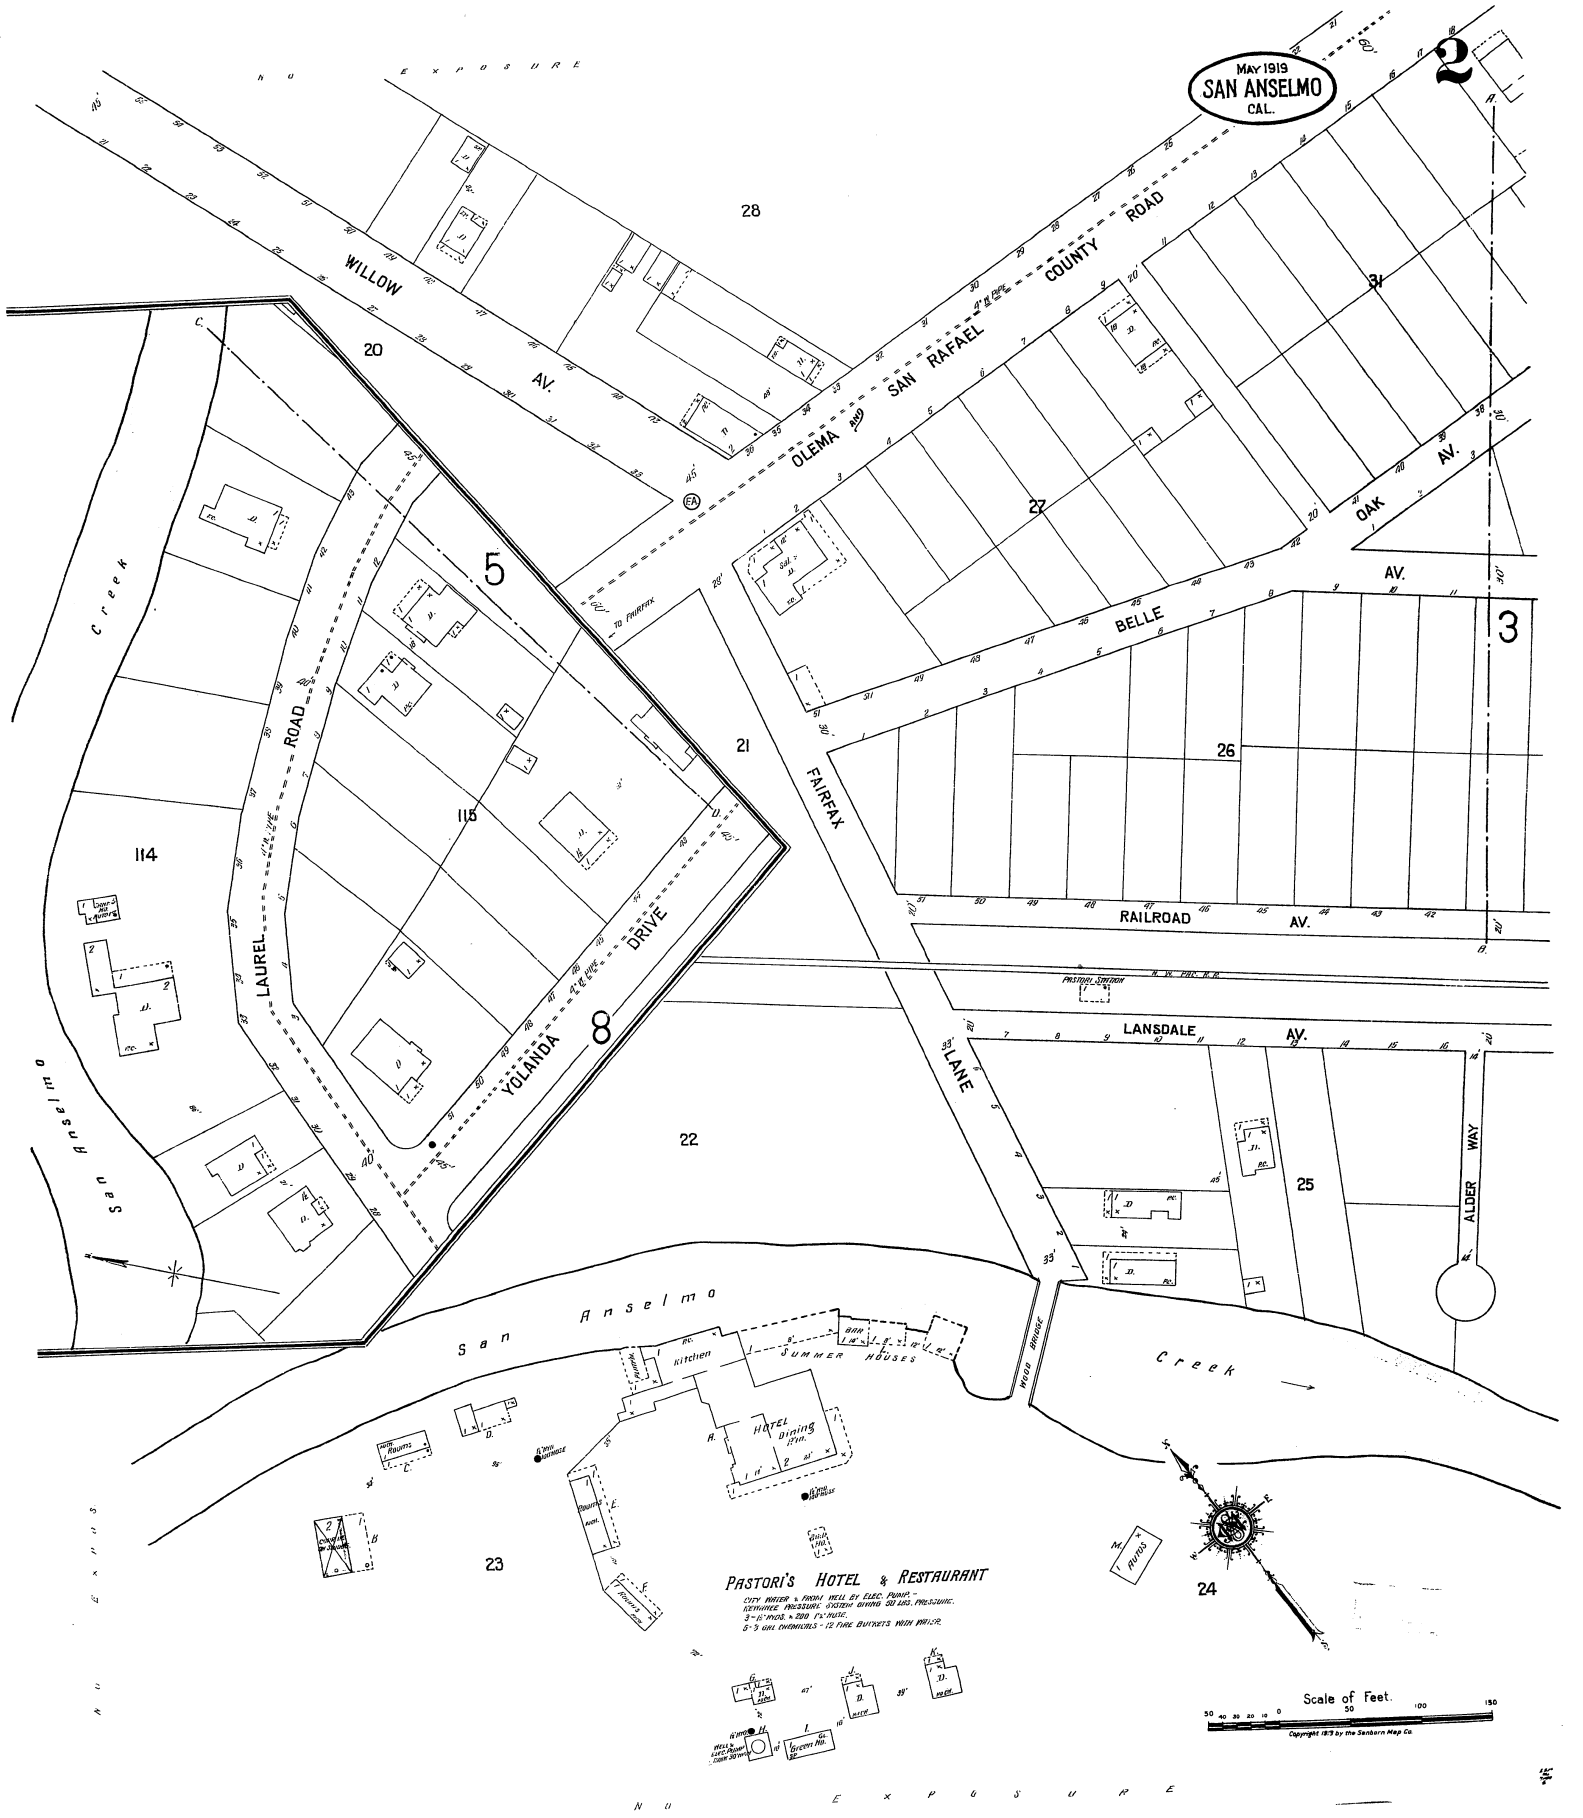

**PASTOR'S HOTEL & RESTAURANT**  
CITY WATER & PUMP WELL BY EACH BUILDING -  
SEWERAGE, PRESSURE, VENTING, DRAINAGE, ETC.  
3-1/2" PIPES, 4" DIA. PIPES.  
5-1/2" GAS CONDUITS - 12 FIRE BURSTERS WITH 100' L.C.

Scale of Feet.  
0 50 100 150  
Copyright 1919 by the Seaborn Map Co.